


R:\Utilstds\City_Std_Details\Water_Uilities\W-308

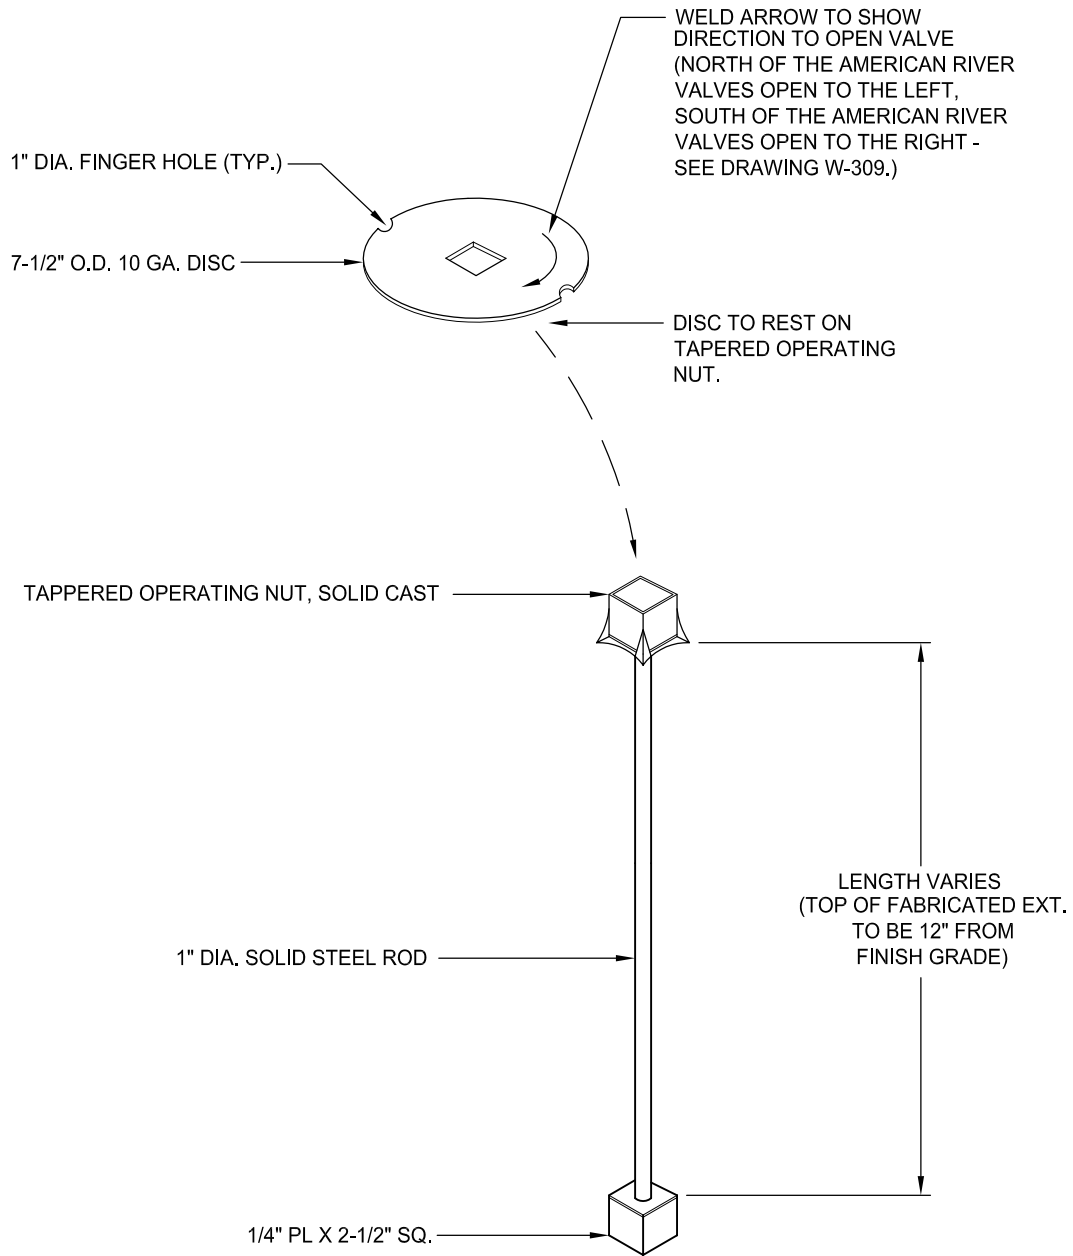

NOTES:

- 1. REQUIRED WHEN VALVE NUT IS IN EXCESS OF 30" BELOW FINISH GRADE.
- 2. SET TOP OF EXTENSION 12" BELOW GRADE.

VALVE OPERATING NUT EXTENSION

REV.	DATE	DESCRIPTION
1		